




ENGINEERING DEPARTMENT
STANDARD DETAILS

SPLASH BLOCK

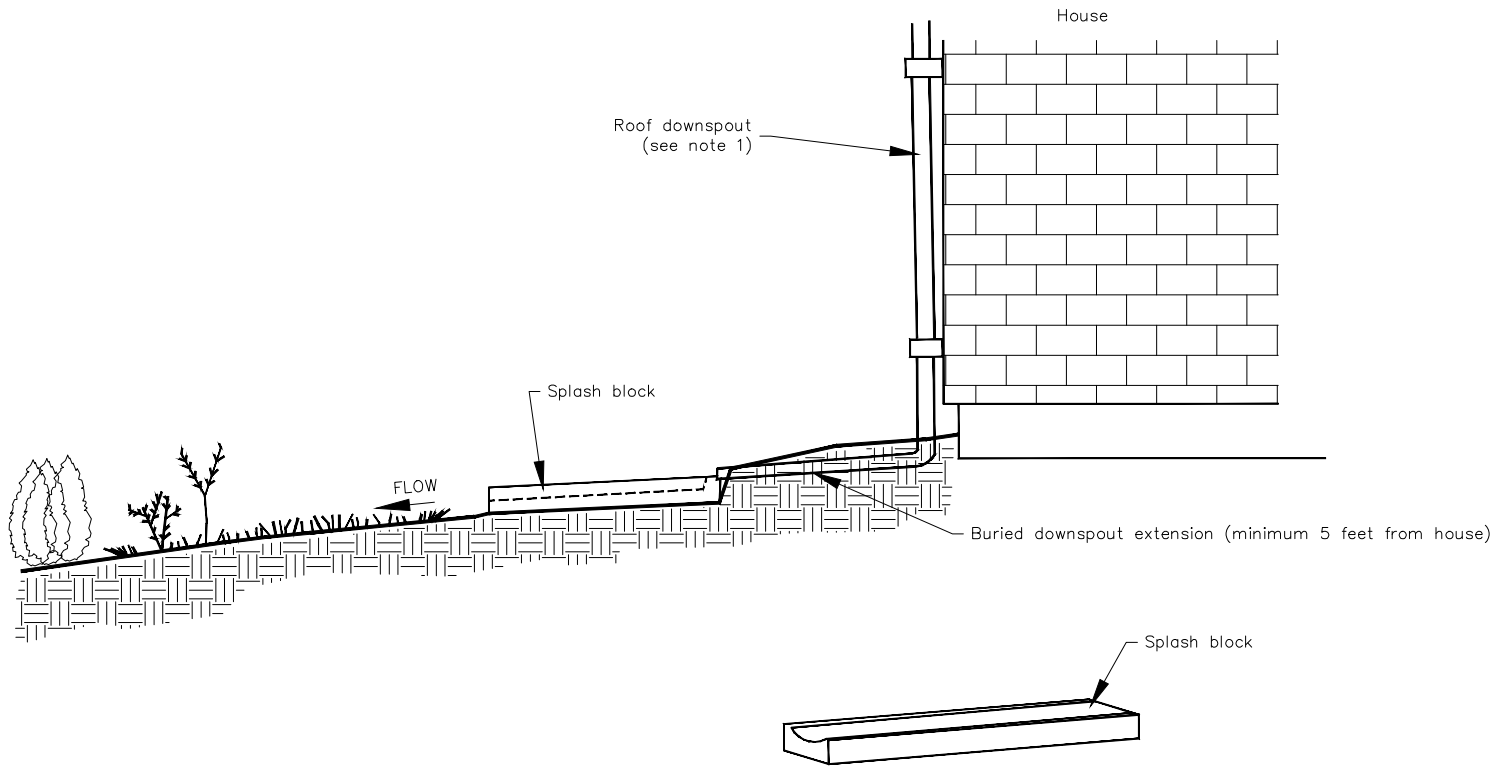

GENERAL NOTES:

1. No more than 700 sq. ft. of roof area may be drained to a single splash block.
2. Splash block shall drain to a minimum of 50 ft. of well established vegetation. If less than 50 ft. of well established vegetation is present then the splash block must discharge to Rock Level Spreader (see detail SD-15).

NOTE: DRAWING NOT TO SCALE

TITLE:	REVISIONS	DET. NO.
SPLASH BLOCK	08/13 15	SD-14