



McADAMS

The John R. McAdams Company, Inc.
2905 Meridian Parkway
Durham, NC 27713

phone 919. 361. 5000
fax 919. 361. 2269
license number: C-0293, C-187

www.mcadamsco.com

CLIENT
TOLL BROTHERS APARTMENT LIVING
1140 VIRGINIA DR
FORT WASHINGTON, PA, 19034
Contact
PHONE: 202.577.6491



BARBEE CHAPEL APARTMENTS
CONDITIONAL ZONING PERMIT
DRAWINGS
5101 BARBEE CHAPEL RD
CHAPEL HILL, NC 27517



REVISIONS

Table with columns: NO., DATE, REVISION. Row 1: 11.23.2022, REVISED PER 1ST C2P COMMENTS

PLAN INFORMATION

Table with columns: PROJECT NO., FILENAME, CHECKED BY, DRAWN BY, SCALE, DATE. Values: TLA-22001, TLA22001-D1, SJC, WHM/LIL, NTS, 09.29.2022

SHEET

SITE DETAILS
C8.00

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. ST-5.2 ACCESSIBLE RAMP

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. ST-5.4 ACCESSIBLE RAMP

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. P-1 LOT LAYOUT SCHEDULE

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. ST-5.3 ACCESSIBLE RAMP

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. N.T.S. CURB TRANSITION DETAILS

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. ST-4 TYPICAL SIDEWALK

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. N.T.S. ACCESSIBLE PARKING SPACE SIGN

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. N.T.S. CONCRETE SIDEWALK

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. ST-2 CURB & GUTTER SECTION

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. N.T.S. ACCESSIBLE SIDEWALK RAMP

STANDARD DETAILS ENGINEERING DEPARTMENT DETAIL NO. N.T.S. STANDARD 24" CURB AND GUTTER, 24" SPILL CURB AND GUTTER, 24" CURB AND GUTTER

SEE SHEET C0.00 FOR ALL PROJECT, SITE, GRADING, STORM DRAINAGE AND UTILITY NOTES

ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE CURRENT TOWN OF CHAPEL HILL AND NCDOT ENGINEERING DESIGN AND CONSTRUCTION STANDARDS

# STORMWATER CONTROL MEASURE 'A' CONSTRUCTION SPECIFICATIONS

## GENERAL NOTES

- PRIOR TO CONSTRUCTION, ANY DISCREPANCIES IN THE PLANS AND NOTES SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION.
- PRIOR TO ANY CONSTRUCTION OR PLACEMENT OF ANY BACKFILL, THE ONSITE GEOTECHNICAL ENGINEER SHALL INSPECT THE EXCAVATION AREA FOR THE UNDERGROUND SCM WITHIN THIS AREA TO ASSESS WHETHER SUITABLE SOILS EXIST AT THE SUBGRADE LEVEL. IF THE CONTRACTOR CONSTRUCTS AND COVERS UP THE UNDERGROUND SCM PRIOR TO INSPECTION, THEN THIS AREA SHALL BE UNCOVERED AND TESTED (TO THE ENGINEER'S AND OWNER'S APPROVAL) AT THE CONTRACTOR'S EXPENSE.
- THE FACILITY SHALL NOT BE USED AS A TEMPORARY EROSION CONTROL DEVICE (I.E. SEDIMENT TRAP OR SEDIMENT BASIN) DURING CONSTRUCTION.
- PRIOR TO PLACING STORMFILTER CARTRIDGES WITHIN THE UNDERGROUND SYSTEM, THE CONTRACTOR SHALL REQUEST AN ONSITE MEETING WITH THE DESIGN ENGINEER AND THE EROSION CONTROL INSPECTOR TO ENSURE THE UPSTREAM DRAINAGE AREA IS COMPLETELY STABILIZED (I.E. GOOD VEGETATIVE COVER). IF THE CONTRACTOR DECIDES TO PLACE THE STORMFILTER CARTRIDGES PRIOR TO APPROVAL FROM THE DESIGN ENGINEER AND THE EROSION CONTROL INSPECTOR, THEN THE CONTRACTOR SHALL EXCAVATE/REPLACE, AS NECESSARY, THE COMPONENTS NEEDED FOR THE SYSTEM TO FUNCTION PROPERLY AT HIS / HER EXPENSE SHOULD THE STORMFILTER CARTRIDGES NOT FUNCTION PROPERLY (I.E. WILL NOT DRAIN DUE TO SEDIMENT DEPOSITION) DUE TO AN UNSTABILIZED UPSTREAM DRAINAGE AREA.
- ONCE CONSTRUCTED, THE STORMFILTER CARTRIDGES SHALL NOT RECEIVE STORMWATER RUNOFF UNTIL THE ENTIRE CONTRIBUTING DRAINAGE AREA TO THE UNDERGROUND SYSTEM HAS BEEN COMPLETELY STABILIZED AND SITE CONSTRUCTION IS COMPLETE.
- ALL COMPONENTS OF THE UNDERGROUND SCM SYSTEM (STORMFILTER MANHOLE, CONCRETE VAULT, JOINT / RISER CONNECTIONS, ENDCAPS, ACCESS MANHOLES, ETC) SHALL BE DESIGNED BY OTHERS. ANY VARIATIONS OR CHANGES MADE FROM THESE SPECIFICATIONS AND DRAWINGS DURING THE ORDERING AND/OR INSTALLATION OF ALL COMPONENTS MUST BE APPROVED BY THE DESIGN ENGINEER. THE STRUCTURAL DESIGN OF THE UNDERGROUND SCM, ALONG WITH ITS ASSUMPTIONS, IS ALSO BY OTHERS. THE JOHN R. MCADAMS COMPANY, INC. AND ITS EMPLOYEES ASSUME NO LIABILITY WITH RESPECT TO ANY ASPECT OF THE STRUCTURAL DESIGN FOR THE UNDERGROUND SCM SYSTEM.
- ALL PIPE / RISER CONNECTIONS AND JOINTS ASSOCIATED WITH THE UNDERGROUND SCM SYSTEM SHALL BE WATER TIGHT. THE MECHANISM FOR ACHIEVING THIS SHALL BE SUBMITTED TO THE DESIGN ENGINEER FOR REVIEWING.
- THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE, AND MAINTAIN ANY PUMPING EQUIPMENT, ETC. NEEDED FOR REMOVAL OF WATER FROM VARIOUS PARTS OF THE UNDERGROUND SCM SYSTEM SITE. IT IS ANTICIPATED THAT PUMPING WILL BE NECESSARY IN THE EXCAVATION AREAS DURING PLACEMENT OF FILL WITHIN THIS AREA (AS NECESSARY). THE CONTRACTOR SHALL KEEP THE WATER LEVEL BELOW THE BOTTOM OF THE EXCAVATION. THE MANNER IN WHICH THE WATER IS REMOVED SHALL BE SUCH THAT THE EXCAVATION BOTTOM AND SIDE SLOPES ARE STABLE.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ADHERE TO ALL CURRENT OSHA REGULATIONS FOR CONFINED SPACE ENTRY AND PROVIDE SUCH DURING ENGINEER WALK-THROUGH/INSPECTION.
- ALL PIPE PENETRATIONS THROUGH A CONCRETE STRUCTURE (I.E. STORMFILTER CARTRIDGE / DETENTION SYSTEM, STORM DRAINAGE MANHOLES, ETC) SHALL BE MADE WATERTIGHT USING NON-SHRINK CEMENTIOUS GROUT.
- EXISTING UTILITIES AND STRUCTURES SHOWN, BOTH UNDERGROUND AND ABOVE GROUND, ARE BASED ON A FIELD SURVEY AND THE BEST AVAILABLE RECORD DRAWINGS. THE CONTRACTOR SHALL VERIFY FIELD CONDITIONS PRIOR TO BEGINNING RELATED CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER IMMEDIATELY.

## STORMWATER MANAGEMENT SYSTEM MATERIAL SPECIFICATIONS

- THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM IS TO BE DESIGNED BY OTHERS. ANY CHANGES TO THE PLANS SHALL BE PROVIDED TO THE DESIGN ENGINEER FOR REVIEW. PRIOR TO INSTALLATION, SHOP DRAWINGS OF THE STORMWATER MANAGEMENT SYSTEM SHALL BE PROVIDED TO THE DESIGN ENGINEER AND TO THE TOWN OF CHAPEL HILL FOR REVIEW.
- FILTER CARTRIDGES SHALL BE CONTECH STORMFILTERS WITH PHOSPHOSORB MEDIA. INSTALLATION OF THE STORMWATER DEVICE SHALL BE PER THE MANUFACTURER'S INSTALLATION GUIDELINES AND SPECIFICATIONS.
- ACCESS RISERS SHALL BE INSTALLED PER STRUCTURAL SPECIFICATIONS. ACCESS STEPS / LADDERS SHALL BE ATTACHED TO THE RISERS TO ALLOW FOR ACCESS INTO THE STORMWATER MANAGEMENT SYSTEM.
- THE 24"Ø DIP OUTLET BARREL OF THE DETENTION SYSTEM SHALL BE CLASS 350 DIP, MEETING THE REQUIREMENTS OF ASTM A716. THE PIPE JOINTS SHALL BE LOCKING JOINTS PER ANSI/AWWA C110/A21.10 OR ANSI/AWWA C153/A21.53 STANDARDS.
- THE CONTRACTOR SHALL INSTALL THE STORMFILTER SYSTEM PER MANUFACTURER'S SPECIFICATIONS. CONTRACTOR TO PROVIDE A LETTER FROM MATERIAL SUPPLIER(S) STATING MATERIALS MEET THE SPECIFIED STANDARDS PRIOR TO INSTALLATION.
- COVER AND REVIEW OF SITE CONDITIONS TO MAINTAIN THE STRUCTURAL INTEGRITY OF THE SYSTEM TO BE THE RESPONSIBILITY OF THE MANUFACTURER.

## STATEMENT OF RESPONSIBILITY

- ALL REQUIRED MAINTENANCE AND INSPECTIONS OF THIS FACILITY SHALL BE THE RESPONSIBILITY OF THE PROPERTY OWNER, PER THE EXECUTED OPERATION AND MAINTENANCE AGREEMENT FOR THIS FACILITY.

## FOUNDATION NOTES

- ONCE THE EXCAVATION IS COMPLETE AND PRIOR TO INSTALLATION OF THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM, THE ONSITE GEOTECHNICAL ENGINEER SHALL VERIFY THE BEARING CAPACITY OF THE UNDERLYING SOILS TO SERVE AS A FOUNDATION FOR THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM. IF THE ONSITE GEOTECHNICAL ENGINEER DEEMS THE FOUNDATION SOILS AS UNSUITABLE, THEN THE UNSUITABLE MATERIAL SHOULD BE REMOVED DOWN TO A SUITABLE DEPTH AND THEN BUILT BACK UP TO THE CORRECT ELEVATION WITH A COMPACTED BACKFILL MATERIAL THAT IS APPROVED BY THE ONSITE GEOTECHNICAL ENGINEER. THE APPROVED BACKFILL MATERIAL SHOULD HAVE A GRADATION THAT WILL NOT ALLOW THE MIGRATION OF FINES, WHICH COULD CAUSE SETTLEMENT OF THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM. IF NECESSARY, A GEOTEXTILE FABRIC CAN BE USED TO SEPARATE THE UNDERLYING SOILS AND THE BACKFILL MATERIAL. THIS GEOTEXTILE FABRIC (IF USED) IS TO BE SPECIFIED BY THE ON-SITE GEOTECHNICAL ENGINEER.
- PLEASE NOTE THAT IF THE CONTRACTOR CONSTRUCTS AND COVERS UP THE EXCAVATION FOR THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM PRIOR TO INSPECTION, THEN THIS AREA SHALL BE UNCOVERED AND TESTED (TO THE ENGINEER'S AND OWNER'S APPROVAL) AT THE CONTRACTOR'S EXPENSE.
- THE FOUNDATION SUBGRADE SHALL BE GRADED TO A UNIFORM OR SLIGHTLY SLOPING GRADE PRIOR TO PLACEMENT OF THE BEDDING MATERIAL. IF THE FOUNDATION SUBGRADE WILL BE EXPOSED FOR AN EXTENDED PERIOD OF TIME DURING CONSTRUCTION, THEN IT SHOULD BE GRADED TO A SLIGHT SLOPE SUCH THAT SATURATION OF THE SUBGRADE DOES NOT OCCUR.
- THE BEDDING MATERIAL FOR THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM SHALL BE SPECIFIED BY THE ON-SITE GEOTECHNICAL ENGINEER. TYPICALLY, A WELL-GRADED GRANULAR MATERIAL WILL BE USED FOR THE BEDDING. PLEASE NOTE THAT IF CONSTRUCTION EQUIPMENT WILL BE OPERATING FOR AN EXTENDED PERIOD OF TIME ON THE BEDDING, THEN THE APPROPRIATE MEASURES (E.G. ENGINEERED FABRIC, STIFF GEOGRID, ETC.) SHALL BE TAKEN TO ENSURE THE INTEGRITY OF THE BEDDING IS NOT COMPROMISED.
- THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE, AND MAINTAIN ANY PUMPING EQUIPMENT, ETC. NEEDED FOR REMOVAL OF WATER FROM THE EXCAVATION. IT IS BEST TO BEGIN THE CONSTRUCTION OF THE DETENTION SYSTEMS AT THE DOWNSTREAM END WITH THE OUTLET ALREADY CONSTRUCTED TO ALLOW A ROUTE FOR WATER TO ESCAPE.
- THE CONTRACTOR SHALL PROVIDE A FOUNDATION DRAIN FOR THE UNDERGROUND DETENTION SYSTEM DESIGNED BY OTHERS. THE UNDERDRAIN SYSTEM SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATION AND SHALL POSITIVELY DRAIN TO DOWNSTREAM STRUCTURE. THE ONSITE GEOTECHNICAL ENGINEER SHALL DETERMINE IF FOUNDATION DRAINS ARE NOT REQUIRED FOR THE UNDERGROUND SCM SYSTEM. THE DESIGN ENGINEER SHALL BE NOTIFIED FOLLOWING THIS DETERMINATION.

## BEDDING NOTES

- THE EXCAVATION SUB GRADE MUST BE TRANSIT LEVEL.
- THE EXCAVATION PIT SHALL BE LINED (ON THE BOTTOM AND ALL FOUR SIDES) WITH A NON-WOVEN GEO-TEXTILE (GEOTEX 401 OR APPROVED EQUIVALENT). THE ONSITE GEOTECHNICAL ENGINEER SHALL APPROVE FABRIC FOR USE.
- THE SUBGRADE FOR THE DETENTION SYSTEM CAN BE A CONCRETE SLAB, OR CLEAN GRANULAR MATERIAL WITH A MAXIMUM AGGREGATE SIZE OF 3/4". THE BEDDING SHALL BE FREE FROM ROCK FORMATIONS, PROTRUDING STONES, FROZEN LUMPS, ROOTS, AND OTHER FOREIGN MATERIAL.
- PREPARE THE SUBGRADE PER THE ONSITE GEOTECHNICAL ENGINEER'S DIRECTION (APPROXIMATELY 5'-6" BELOW GRADE ON WHICH SLAB WILL SET). THE BEDDING MATERIAL SHOULD BE GRADED SUCH THAT A SMOOTH UNIFORM GRADE IS ESTABLISHED TO ALLOW FOR OPTIMUM PLACEMENT OF THE SAND FILTER.
- THE SUBGRADE MUST SUPPORT THE DETENTION SYSTEM WITHOUT DIFFERENTIAL SETTLEMENT BETWEEN PIECES.
- IF CONSTRUCTION EQUIPMENT WILL BE OPERATING FOR AN EXTENDED PERIOD OF TIME ON THE BEDDING, THEN THE APPROPRIATE MEASURES (E.G. STIFF GEOGRID, ETC.) SHALL BE TAKEN TO ENSURE THE INTEGRITY OF THE BEDDING IS NOT COMPROMISED.

## BACKFILL MATERIAL NOTES



- THE ON-SITE GEOTECHNICAL ENGINEER SHALL SPECIFY THE BACKFILL MATERIAL FOR THE STORMWATER MANAGEMENT SYSTEM.
- THE BACKFILL MATERIAL SHOULD BE FREE OF ROCKS, FROZEN LUMPS, AND OTHER FOREIGN MATTER THAT COULD CAUSE HARD SPOTS WITHIN THE BACKFILL MATERIAL, OR THAT COULD DECOMPOSE AND CREATE VOIDS.
- HIGHLY PLASTIC SILTS, HIGHLY PLASTIC CLAYS, ORGANIC SILTS, ORGANIC CLAYS, AND PEATS SHOULD NOT BE USED AS A BACKFILL MATERIAL.
- THE BACKFILL MATERIAL SHOULD BE PLACED IN 6" LOOSE LIFTS AND COMPACTED TO 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY (ASTM-D698). THE FILL SOILS SHALL BE COMPACTED AT A MOISTURE CONTENT WITHIN +/- TWO PERCENT OF ITS OPTIMUM MOISTURE CONTENT.
- ANY MATERIAL STOCKPILING ON TOP OF THE STORMWATER MANAGEMENT SYSTEM SHALL BE APPROVED BY THE STRUCTURAL DESIGN ENGINEER OR DETENTION SYSTEM MANUFACTURER.

## UNDERGROUND VAULT CONSTRUCTION NOTES

- UNDERGROUND VAULT CONFIGURATION IS TO BE DESIGNED AND PROVIDED BY OTHERS.
- ABSOLUTELY NO RUNOFF SHALL ENTER THE UNDERGROUND VAULT UNTIL ALL CONTRIBUTING DRAINAGE AREAS HAVE BEEN STABILIZED.
- MANHOLE ACCESS SHALL BE PROVIDED FOR THE UNDERGROUND VAULT. MANHOLES SHALL BE IN COMPLIANCE WITH TOWN OF CHAPEL HILL STANDARD DETAIL AND SHALL BE A MINIMUM OF 24 INCHES IN DIAMETER TO COMPLY WITH OSHA CONFINED SPACE REQUIREMENTS (OR MINIMUM OSHA REQUIREMENTS APPLICABLE AT TIME OF CONSTRUCTION). CONTRACTOR SHALL PROVIDE ACCESS LADDERS FOR ACCESS BELOW ALL MANHOLES. MANHOLE COVERS SHALL ALLOW FOR PROPER VENTILATION.

## SYSTEM TESTING NOTES

- PRIOR TO PLACEMENT OF THE BACKFILL MATERIAL AND STORM FILTER CARTRIDGES, CONTRACTOR SHALL TEST FOR WATER TIGHTNESS. ENTRANCES AND EXITS SHALL BE PLUGGED AND THE SYSTEM COMPLETELY FILLED WITH WATER TO DEMONSTRATE WATER TIGHTNESS. WATER TIGHTNESS MEANS NO SIGNIFICANT FOR A PERIOD OF 24 HOURS. SIGNIFICANT LEAKAGE TO BE DETERMINED BY THE CERTIFYING WATER ENGINEER. CONTRACTOR SHALL PLAN AND SCHEDULE THE FIELD TESTING OF THE SYSTEM (WATER TIGHTNESS) WITH THE ENGINEER AT LEAST 2 WORKING DAYS PRIOR TO THE TEST. THE CONTRACTOR SHALL PROVIDE WRITTEN REPORTS TO THE ENGINEER VERIFYING THE WATER TIGHTNESS OF THE STORMWATER VAULT.

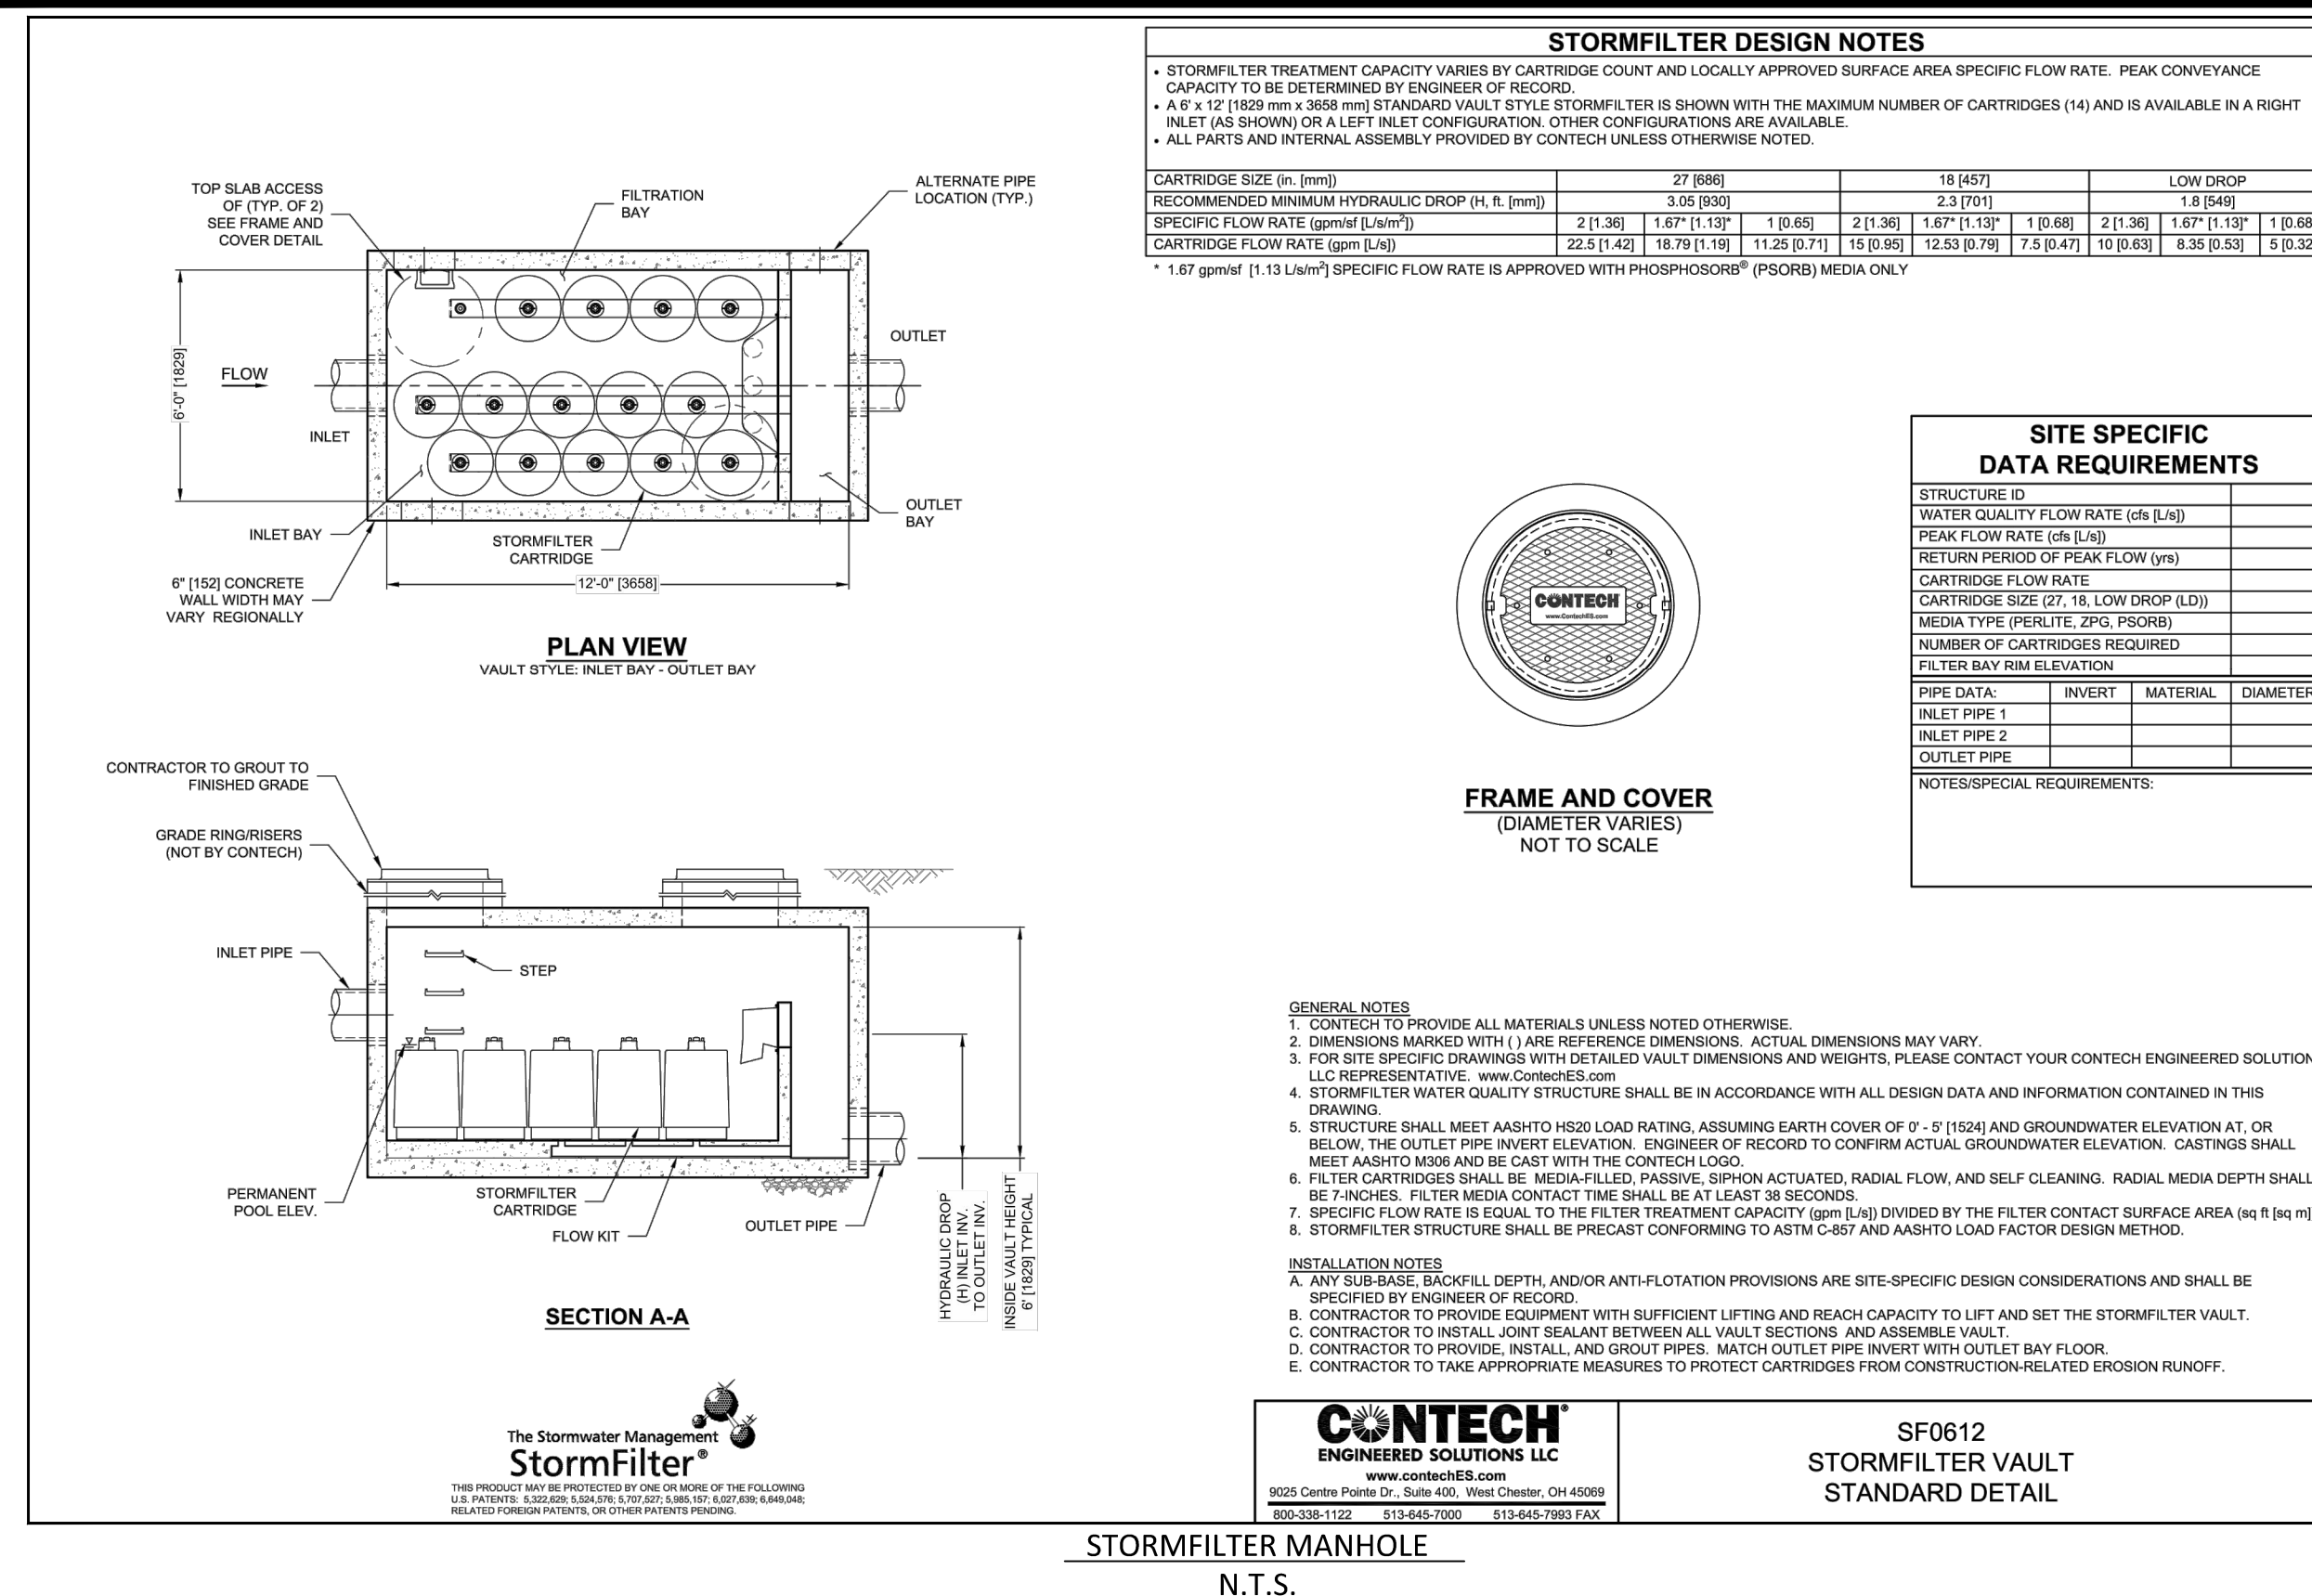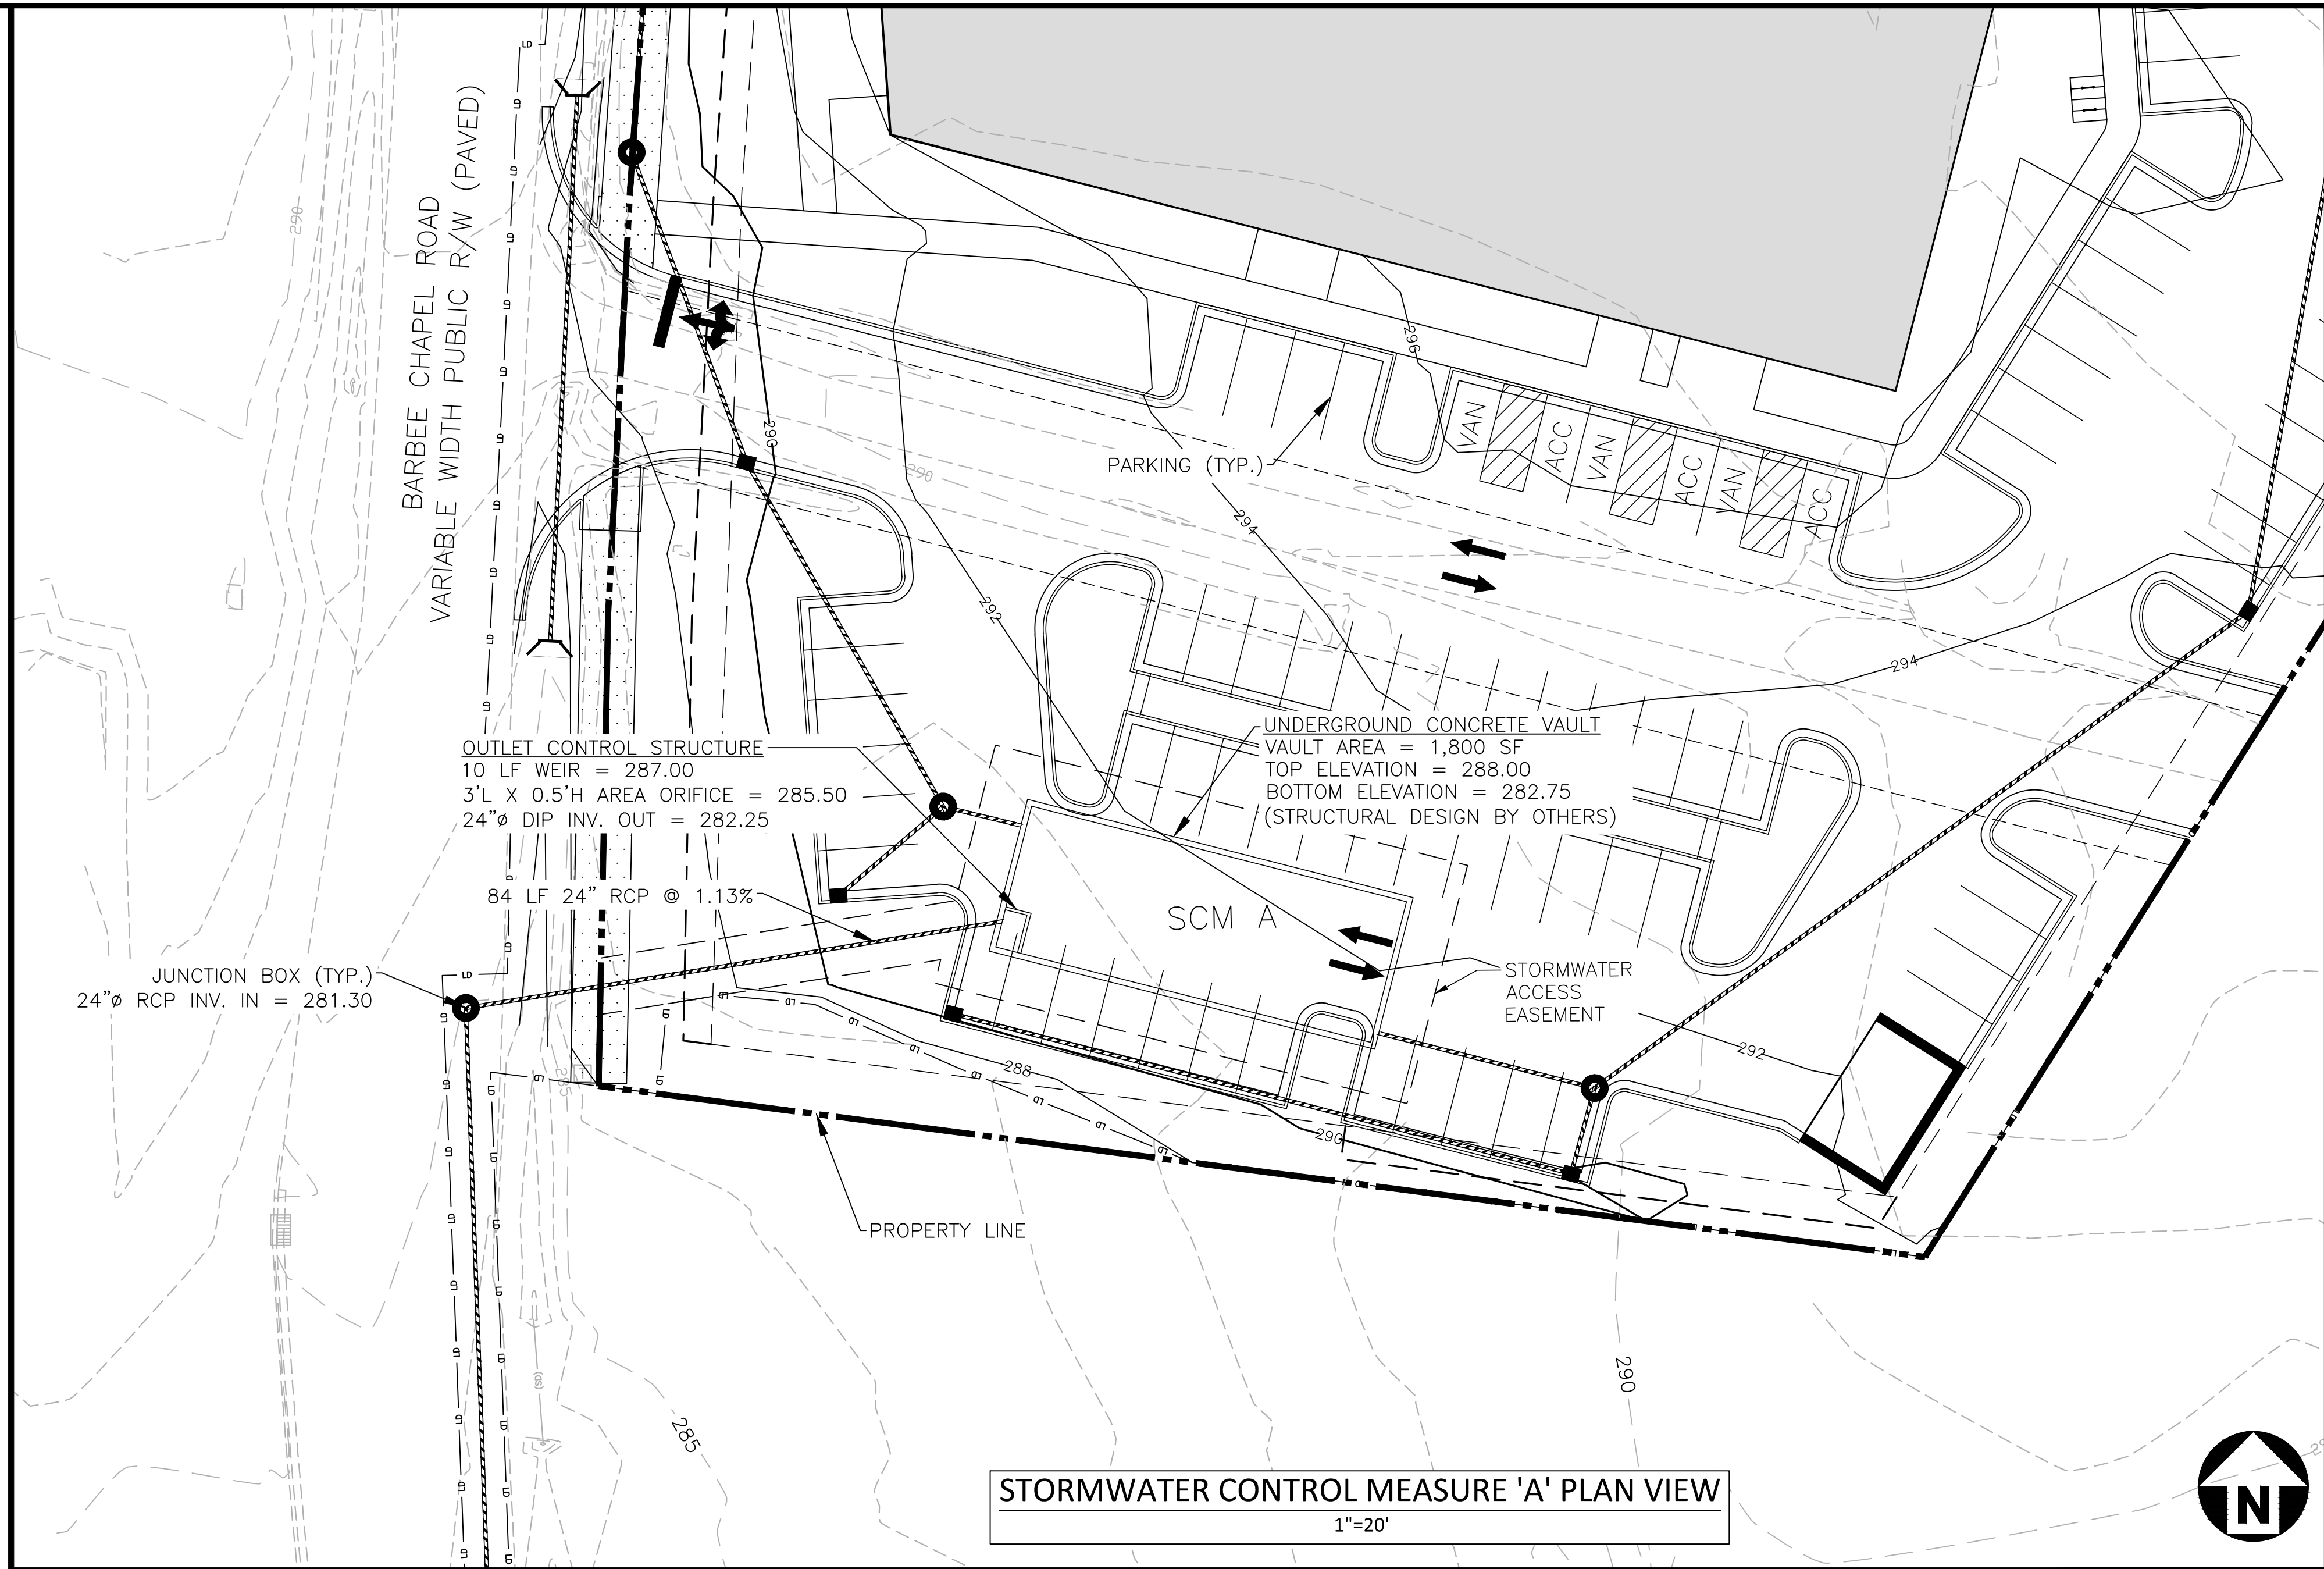

**McADAMS**  
The John R. McAdams Company, Inc.  
2905 Meridian Parkway  
Durham, NC 27713  
phone 919. 361. 5000  
fax 919. 361. 2269  
license number: C-0293, C-187  
[www.mcadamsco.com](http://www.mcadamsco.com)

**CLIENT**  
TOLL BROTHERS APARTMENT LIVING  
1140 VIRGINIA DR  
FORT WASHINGTON, PA, 19034  
Contact  
PHONE: 202.577.6491



**BARBEE CHAPEL APARTMENTS**  
CONDITIONAL ZONING PERMIT  
DRAWINGS  
5101 BARBEE CHAPEL RD  
CHAPEL HILL, NC 27517



**REVISIONS**

NO.	DATE	REVISED PER
11.23.2022	REVISED PER 1ST C2P COMMENTS	

**PLAN INFORMATION**

PROJECT NO. TLA-22001  
FILENAME TLA22001-SCMA  
CHECKED BY MCT  
DRAWN BY OVL  
SCALE 1" = 20'  
DATE 09.29.2022

**SHEET**

SCM A PLAN VIEW  
**C9.00**

SEE SHEET C0.00 FOR ALL PROJECT, SITE, GRADING, STORM DRAINAGE AND UTILITY NOTES

ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE CURRENT TOWN OF CHAPEL HILL AND NCDOT ENGINEERING DESIGN AND CONSTRUCTION STANDARDS

M:\Projects\TLA\22001\04-Production\Water Resources\C2P\Current Drawings\Construction Drawings\TLA22001-SCMA.dwg, 11/23/2022 12:25:53 PM, Spencer Christensen

# STORMWATER CONTROL MEASURE 'B' CONSTRUCTION SPECIFICATIONS

## GENERAL NOTES

- PRIOR TO CONSTRUCTION, ANY DISCREPANCIES IN THE PLANS AND NOTES SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION.
- PRIOR TO ANY CONSTRUCTION OR PLACEMENT OF ANY BACKFILL, THE ONSITE GEOTECHNICAL ENGINEER SHALL INSPECT THE EXCAVATION AREA FOR THE UNDERGROUND SCM WITHIN THIS AREA TO ASSESS WHETHER SUITABLE SOILS EXIST AT THE SUBGRADE LEVEL. IF THE CONTRACTOR CONSTRUCTS AND COVERS UP THE UNDERGROUND SCM PRIOR TO INSPECTION, THEN THIS AREA SHALL BE UNCOVERED AND TESTED (TO THE ENGINEER'S AND OWNER'S APPROVAL) AT THE CONTRACTOR'S EXPENSE.
- THE FACILITY SHALL NOT BE USED AS A TEMPORARY EROSION CONTROL DEVICE (I.E. SEDIMENT TRAP OR SEDIMENT BASIN) DURING CONSTRUCTION.
- PRIOR TO PLACING STORMFILTER CARTRIDGES WITHIN THE UNDERGROUND SYSTEM, THE CONTRACTOR SHALL REQUEST AN ONSITE MEETING WITH THE DESIGN ENGINEER AND THE EROSION CONTROL INSPECTOR TO ENSURE THE UPSTREAM DRAINAGE AREA IS COMPLETELY STABILIZED (I.E. GOOD VEGETATIVE COVER). IF THE CONTRACTOR DECIDES TO PLACE THE STORMFILTER CARTRIDGES PRIOR TO APPROVAL FROM THE DESIGN ENGINEER AND THE EROSION CONTROL INSPECTOR, THEN THE CONTRACTOR SHALL EXCAVATE/REPLACE, AS NECESSARY, THE COMPONENTS NEEDED FOR THE SYSTEM TO FUNCTION PROPERLY AT HIS / HER EXPENSE SHOULD THE STORMFILTER CARTRIDGES NOT FUNCTION PROPERLY (I.E. WILL NOT DRAIN DUE TO SEDIMENT DEPOSITION) DUE TO AN UNSTABILIZED UPSTREAM DRAINAGE AREA.
- ONCE CONSTRUCTED, THE STORMFILTER CARTRIDGES SHALL NOT RECEIVE STORMWATER RUNOFF UNTIL THE ENTIRE CONTRIBUTING DRAINAGE AREA TO THE UNDERGROUND SYSTEM HAS BEEN COMPLETELY STABILIZED AND SITE CONSTRUCTION IS COMPLETE.
- ALL COMPONENTS OF THE UNDERGROUND SCM SYSTEM (STORMFILTER MANHOLE, CONCRETE VAULT, JOINT / RISER CONNECTIONS, ENDCAPS, ACCESS MANHOLES, ETC.) SHALL BE DESIGNED BY OTHERS. ANY VARIATIONS OR CHANGES MADE FROM THESE SPECIFICATIONS AND DRAWINGS DURING THE ORDERING AND/OR INSTALLATION OF ALL COMPONENTS MUST BE APPROVED BY THE DESIGN ENGINEER. THE STRUCTURAL DESIGN OF THE UNDERGROUND SCM, ALONG WITH ITS ASSUMPTIONS, IS ALSO BY OTHERS. THE JOHN R. McADAMS COMPANY, INC. AND ITS EMPLOYEES ASSUME NO LIABILITY WITH RESPECT TO ANY ASPECT OF THE STRUCTURAL DESIGN FOR THE UNDERGROUND SCM SYSTEM.
- ALL PIPE / RISER CONNECTIONS AND JOINTS ASSOCIATED WITH THE UNDERGROUND SCM SYSTEM SHALL BE WATER TIGHT. THE MECHANISM FOR ACHIEVING THIS SHALL BE SUBMITTED TO THE DESIGN ENGINEER FOR REVIEW.
- THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE, AND MAINTAIN ANY PUMPING EQUIPMENT, ETC. NEEDED FOR REMOVAL OF WATER FROM VARIOUS PARTS OF THE UNDERGROUND SCM SYSTEM SITE. IT IS ANTICIPATED THAT PUMPING WILL BE NECESSARY IN THE EXCAVATION AREAS. DURING PLACEMENT OF FILL WITHIN THIS AREA (OR OTHER AREAS AS NECESSARY), THE CONTRACTOR SHALL KEEP THE WATER LEVEL BELOW THE BOTTOM OF THE EXCAVATION. THE MANNER IN WHICH THE WATER IS REMOVED SHALL BE SUCH THAT THE EXCAVATION BOTTOM AND SIDE SLOPES ARE STABLE.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ADHERE TO ALL CURRENT OSHA REGULATIONS FOR CONFINED SPACE ENTRY AND PROVIDE SUCH DURING ENGINEER WALK-THROUGH/INSPECTION.
- ALL PIPE PENETRATIONS THROUGH A CONCRETE STRUCTURE (I.E. STORMFILTER CARTRIDGE / DETENTION SYSTEM, STORM DRAINAGE MANHOLES, ETC.) SHALL BE MADE WATERTIGHT USING NON-SHRINK CEMENTITIOUS GROUT.
- EXISTING UTILITIES AND STRUCTURES SHOWN, BOTH UNDERGROUND AND ABOVE GROUND, ARE BASED ON A FIELD SURVEY AND THE BEST AVAILABLE RECORD DRAWINGS. THE CONTRACTOR SHALL VERIFY FIELD CONDITIONS PRIOR TO BEGINNING RELATED CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER IMMEDIATELY.

## STORMWATER MANAGEMENT SYSTEM MATERIAL SPECIFICATIONS

- THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM IS TO BE DESIGNED BY OTHERS. ANY CHANGES TO THE PLANS SHALL BE PROVIDED TO THE DESIGN ENGINEER FOR REVIEW. PRIOR TO INSTALLATION, SHOP DRAWINGS OF THE STORMWATER MANAGEMENT SYSTEM SHALL BE PROVIDED TO THE DESIGN ENGINEER AND TO THE TOWN OF CHAPEL HILL FOR REVIEW.
- FILTER CARTRIDGES SHALL BE CONTECH STORMFILTERS WITH PHOSPHOSORB MEDIA. INSTALLATION OF THE STORMWATER DEVICE SHALL BE PER THE MANUFACTURER'S INSTALLATION GUIDELINES AND SPECIFICATIONS.
- ACCESS RISERS SHALL BE INSTALLED PER STRUCTURAL SPECIFICATIONS. ACCESS STEPS / LADDERS SHALL BE ATTACHED TO THE RISERS TO ALLOW FOR ACCESS INTO THE STORMWATER MANAGEMENT SYSTEM.
- THE 24" DIP OUTLET BARREL OF THE DETENTION SYSTEM SHALL BE CLASS 350 DIP, MEETING THE REQUIREMENTS OF ASTM A716. THE PIPE JOINTS SHALL BE LOCKING JOINTS PER ANSI/AWWA C110/A21.10 OR ANSI/AWWA C153/A21.53 STANDARDS.
- THE CONTRACTOR SHALL INSTALL THE STORMFILTER SYSTEM PER MANUFACTURER'S SPECIFICATIONS. CONTRACTOR TO PROVIDE A LETTER FROM MATERIAL SUPPLIER(S) STATING MATERIALS MEET THE SPECIFIED STANDARDS PRIOR TO INSTALLATION.
- COVER AND REVIEW OF SITE CONDITIONS TO MAINTAIN THE STRUCTURAL INTEGRITY OF THE SYSTEM TO BE THE RESPONSIBILITY OF THE MANUFACTURER.

## STATEMENT OF RESPONSIBILITY

- ALL REQUIRED MAINTENANCE AND INSPECTIONS OF THIS FACILITY SHALL BE THE RESPONSIBILITY OF THE PROPERTY OWNER, PER THE EXECUTED OPERATION AND MAINTENANCE AGREEMENT FOR THIS FACILITY.

## FOUNDATION NOTES

- ONCE THE EXCAVATION IS COMPLETE AND PRIOR TO INSTALLATION OF THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM, THE ONSITE GEOTECHNICAL ENGINEER SHALL VERIFY THE BEARING CAPACITY OF THE UNDERLYING SOILS TO SERVE AS A FOUNDATION FOR THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM. IF THE ONSITE GEOTECHNICAL ENGINEER DETERMINES THE FOUNDATION SOILS AS UNSUITABLE, THEN THE UNSUITABLE MATERIAL SHOULD BE REMOVED DOWN TO A SUITABLE DEPTH AND THEN BUILT BACK UP TO THE CORRECT ELEVATION WITH A COMPACTED BACKFILL MATERIAL THAT IS APPROVED BY THE ONSITE GEOTECHNICAL ENGINEER. THE APPROVED BACKFILL MATERIAL SHOULD HAVE A GRADATION THAT WILL NOT ALLOW THE MIGRATION OF FINES, WHICH COULD CAUSE SETTLEMENT OF THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM. IF NECESSARY, A GEOTEXTILE FABRIC CAN BE USED TO SEPARATE THE UNDERLYING SOILS AND THE BACKFILL MATERIAL. THIS GEOTEXTILE FABRIC (IF USED) IS TO BE SPECIFIED BY THE ONSITE GEOTECHNICAL ENGINEER.
- PLEASE NOTE THAT IF THE CONTRACTOR CONSTRUCTS AND COVERS UP THE EXCAVATION FOR THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM PRIOR TO INSPECTION, THEN THIS AREA SHALL BE UNCOVERED AND TESTED (TO THE ENGINEER'S AND OWNER'S APPROVAL) AT THE CONTRACTOR'S EXPENSE.
- THE FOUNDATION SUBGRADE SHALL BE GRADED TO A UNIFORM OR SLIGHTLY SLOPING GRADE PRIOR TO PLACEMENT OF THE BEDDING MATERIAL. IF THE FOUNDATION SUBGRADE WILL BE EXPOSED FOR AN EXTENDED PERIOD OF TIME DURING CONSTRUCTION, THEN IT SHOULD BE GRADED TO A SLIGHT SLOPE SUCH THAT SATURATION OF THE SUBGRADE DOES NOT OCCUR.
- THE BEDDING MATERIAL FOR THE UNDERGROUND STORMWATER MANAGEMENT SYSTEM SHALL BE SPECIFIED BY THE ONSITE GEOTECHNICAL ENGINEER. TYPICALLY, A WELL-GRADED GRANULAR MATERIAL WILL BE USED FOR THE BEDDING. PLEASE NOTE THAT IF CONSTRUCTION EQUIPMENT WILL BE OPERATING FOR AN EXTENDED PERIOD OF TIME ON THE BEDDING, THEN THE APPROPRIATE MEASURES (E.G. ENGINEERED FABRIC, STIFF GEOGRID, ETC.) SHALL BE TAKEN TO ENSURE THE INTEGRITY OF THE BEDDING IS NOT COMPROMISED.
- THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE, AND MAINTAIN ANY PUMPING EQUIPMENT, ETC. NEEDED FOR REMOVAL OF WATER FROM THE EXCAVATION. IT IS BEST TO BEGIN THE CONSTRUCTION OF THE DETENTION SYSTEMS AT THE DOWNSTREAM END WITH THE OUTLET ALREADY CONSTRUCTED TO ALLOW A ROUTE FOR WATER TO ESCAPE.
- THE CONTRACTOR SHALL PROVIDE A FOUNDATION DRAIN FOR THE UNDERGROUND DETENTION SYSTEM DESIGNED BY OTHERS. THE UNDERDRAIN SYSTEM SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATION AND SHALL POSITIVELY DRAIN TO DOWNSTREAM STRUCTURE. THE ONSITE GEOTECHNICAL ENGINEER SHALL DETERMINE IF FOUNDATION DRAINS ARE NOT REQUIRED FOR THE UNDERGROUND SCM SYSTEM. THE DESIGN ENGINEER SHALL BE NOTIFIED FOLLOWING THIS DETERMINATION.

## BEDDING NOTES

- THE EXCAVATION SUB GRADE MUST BE TRANSIT LEVEL.
- THE EXCAVATION PIT SHALL BE LINED (ON THE BOTTOM AND ALL FOUR SIDES) WITH A NON-WOVEN GEO-TEXTILE (GEOTEX 401 OR APPROVED EQUIVALENT). THE ONSITE GEOTECHNICAL ENGINEER SHALL APPROVE FABRIC FOR USE.
- THE SUBGRADE FOR THE DETENTION SYSTEM CAN BE A CONCRETE SLAB, OR CLEAN GRANULAR MATERIAL WITH A MAXIMUM AGGREGATE SIZE OF 3/4". THE BEDDING SHALL BE FREE FROM ROCK FORMATIONS, PROTRUDING STONES, FROZEN LUMPS, ROOTS, AND OTHER FOREIGN MATERIAL.
- PREPARE THE SUBGRADE PER THE ONSITE GEOTECHNICAL ENGINEER'S DIRECTION (APPROXIMATELY 5'-6" BELOW GRADE ON WHICH SLAB WILL SET). THE BEDDING MATERIAL SHOULD BE GRADED SUCH THAT A SMOOTH UNIFORM GRADE IS ESTABLISHED TO ALLOW FOR OPTIMUM PLACEMENT OF THE SAND FILTER.
- THE SUBGRADE MUST SUPPORT THE DETENTION SYSTEM WITHOUT DIFFERENTIAL SETTLEMENT BETWEEN PIECES.
- IF CONSTRUCTION EQUIPMENT WILL BE OPERATING FOR AN EXTENDED PERIOD OF TIME ON THE BEDDING, THEN THE APPROPRIATE MEASURES (E.G. STIFF GEOGRID, ETC.) SHALL BE TAKEN TO ENSURE THE INTEGRITY OF THE BEDDING IS NOT COMPROMISED.

## BACKFILL MATERIAL NOTES


- THE ONSITE GEOTECHNICAL ENGINEER SHALL SPECIFY THE BACKFILL MATERIAL FOR THE STORMWATER MANAGEMENT SYSTEM.
- THE BACKFILL MATERIAL SHOULD BE FREE OF ROCKS, FROZEN LUMPS, AND OTHER FOREIGN MATTER THAT COULD CAUSE HARD SPOTS WITHIN THE BACKFILL MATERIAL, OR THAT COULD DECOMPOSE AND CREATE VOIDS.
- HIGHLY PLASTIC SILTS, HIGHLY PLASTIC CLAYS, ORGANIC CLAYS, AND PEATS SHOULD NOT BE USED AS A BACKFILL MATERIAL.
- THE BACKFILL MATERIAL SHOULD BE PLACED IN 6" LOOSE LIFTS AND COMPACTED TO 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY (ASTM D698). THE FILL SOILS SHALL BE COMPACTED AT A MOISTURE CONTENT WITHIN +/- TWO PERCENT OF ITS OPTIMUM MOISTURE CONTENT.
- ANY MATERIAL STOCKPILING ON TOP OF THE STORMWATER MANAGEMENT SYSTEM SHALL BE APPROVED BY THE STRUCTURAL DESIGN ENGINEER OR DETENTION SYSTEM MANUFACTURER.

## UNDERGROUND VAULT CONSTRUCTION NOTES


- UNDERGROUND VAULT CONFIGURATION IS TO BE DESIGNED AND PROVIDED BY OTHERS.
- ABSOLUTELY NO RUNOFF SHALL ENTER THE UNDERGROUND VAULT UNTIL ALL CONTRIBUTING DRAINAGE AREAS HAVE BEEN STABILIZED.
- MANHOLE ACCESS SHALL BE PROVIDED FOR THE UNDERGROUND VAULT. MANHOLES SHALL BE IN COMPLIANCE WITH TOWN OF CHAPEL HILL STANDARD DETAILS BUT SHALL BE A MINIMUM OF 24 INCHES IN DIAMETER TO COMPLY WITH OSHA CONFINED SPACE REQUIREMENTS (OR MINIMUMS OTHERWISE SPECIFIED AT TIME OF CONSTRUCTION). CONTRACTOR SHALL PROVIDE ACCESS LADDERS FOR ACCESS BELOW ALL MANHOLES. MANHOLE COVERS SHALL ALLOW FOR PROPER VENTILATION.

## SYSTEM TESTING NOTES

- PRIOR TO PLACEMENT OF THE BACKFILL MATERIAL AND STORM FILTER CARTRIDGES, CONTRACTOR SHALL TEST FOR WATER TIGHTNESS. ENTRANCES AND EXITS SHALL BE PLUGGED AND THE SYSTEM COMPLETELY FILLED WITH WATER TO DEMONSTRATE WATER TIGHTNESS. WATER TIGHTNESS MEANS NO SIGNIFICANT FOR A PERIOD OF 24 HOURS. SIGNIFICANT LEAKAGE TO BE DETERMINED BY THE CERTIFYING ENGINEER. CONTRACTOR SHALL CALL AND SCHEDULE THE FIELD TESTING OF THE SYSTEM (WATER TIGHTNESS) WITH THE ENGINEER AT LEAST 2 WORKING DAYS PRIOR TO THE TEST. THE CONTRACTOR SHALL PROVIDE WRITTEN REPORTS TO THE ENGINEER VERIFYING THE WATER TIGHTNESS OF THE STORMWATER VAULT.

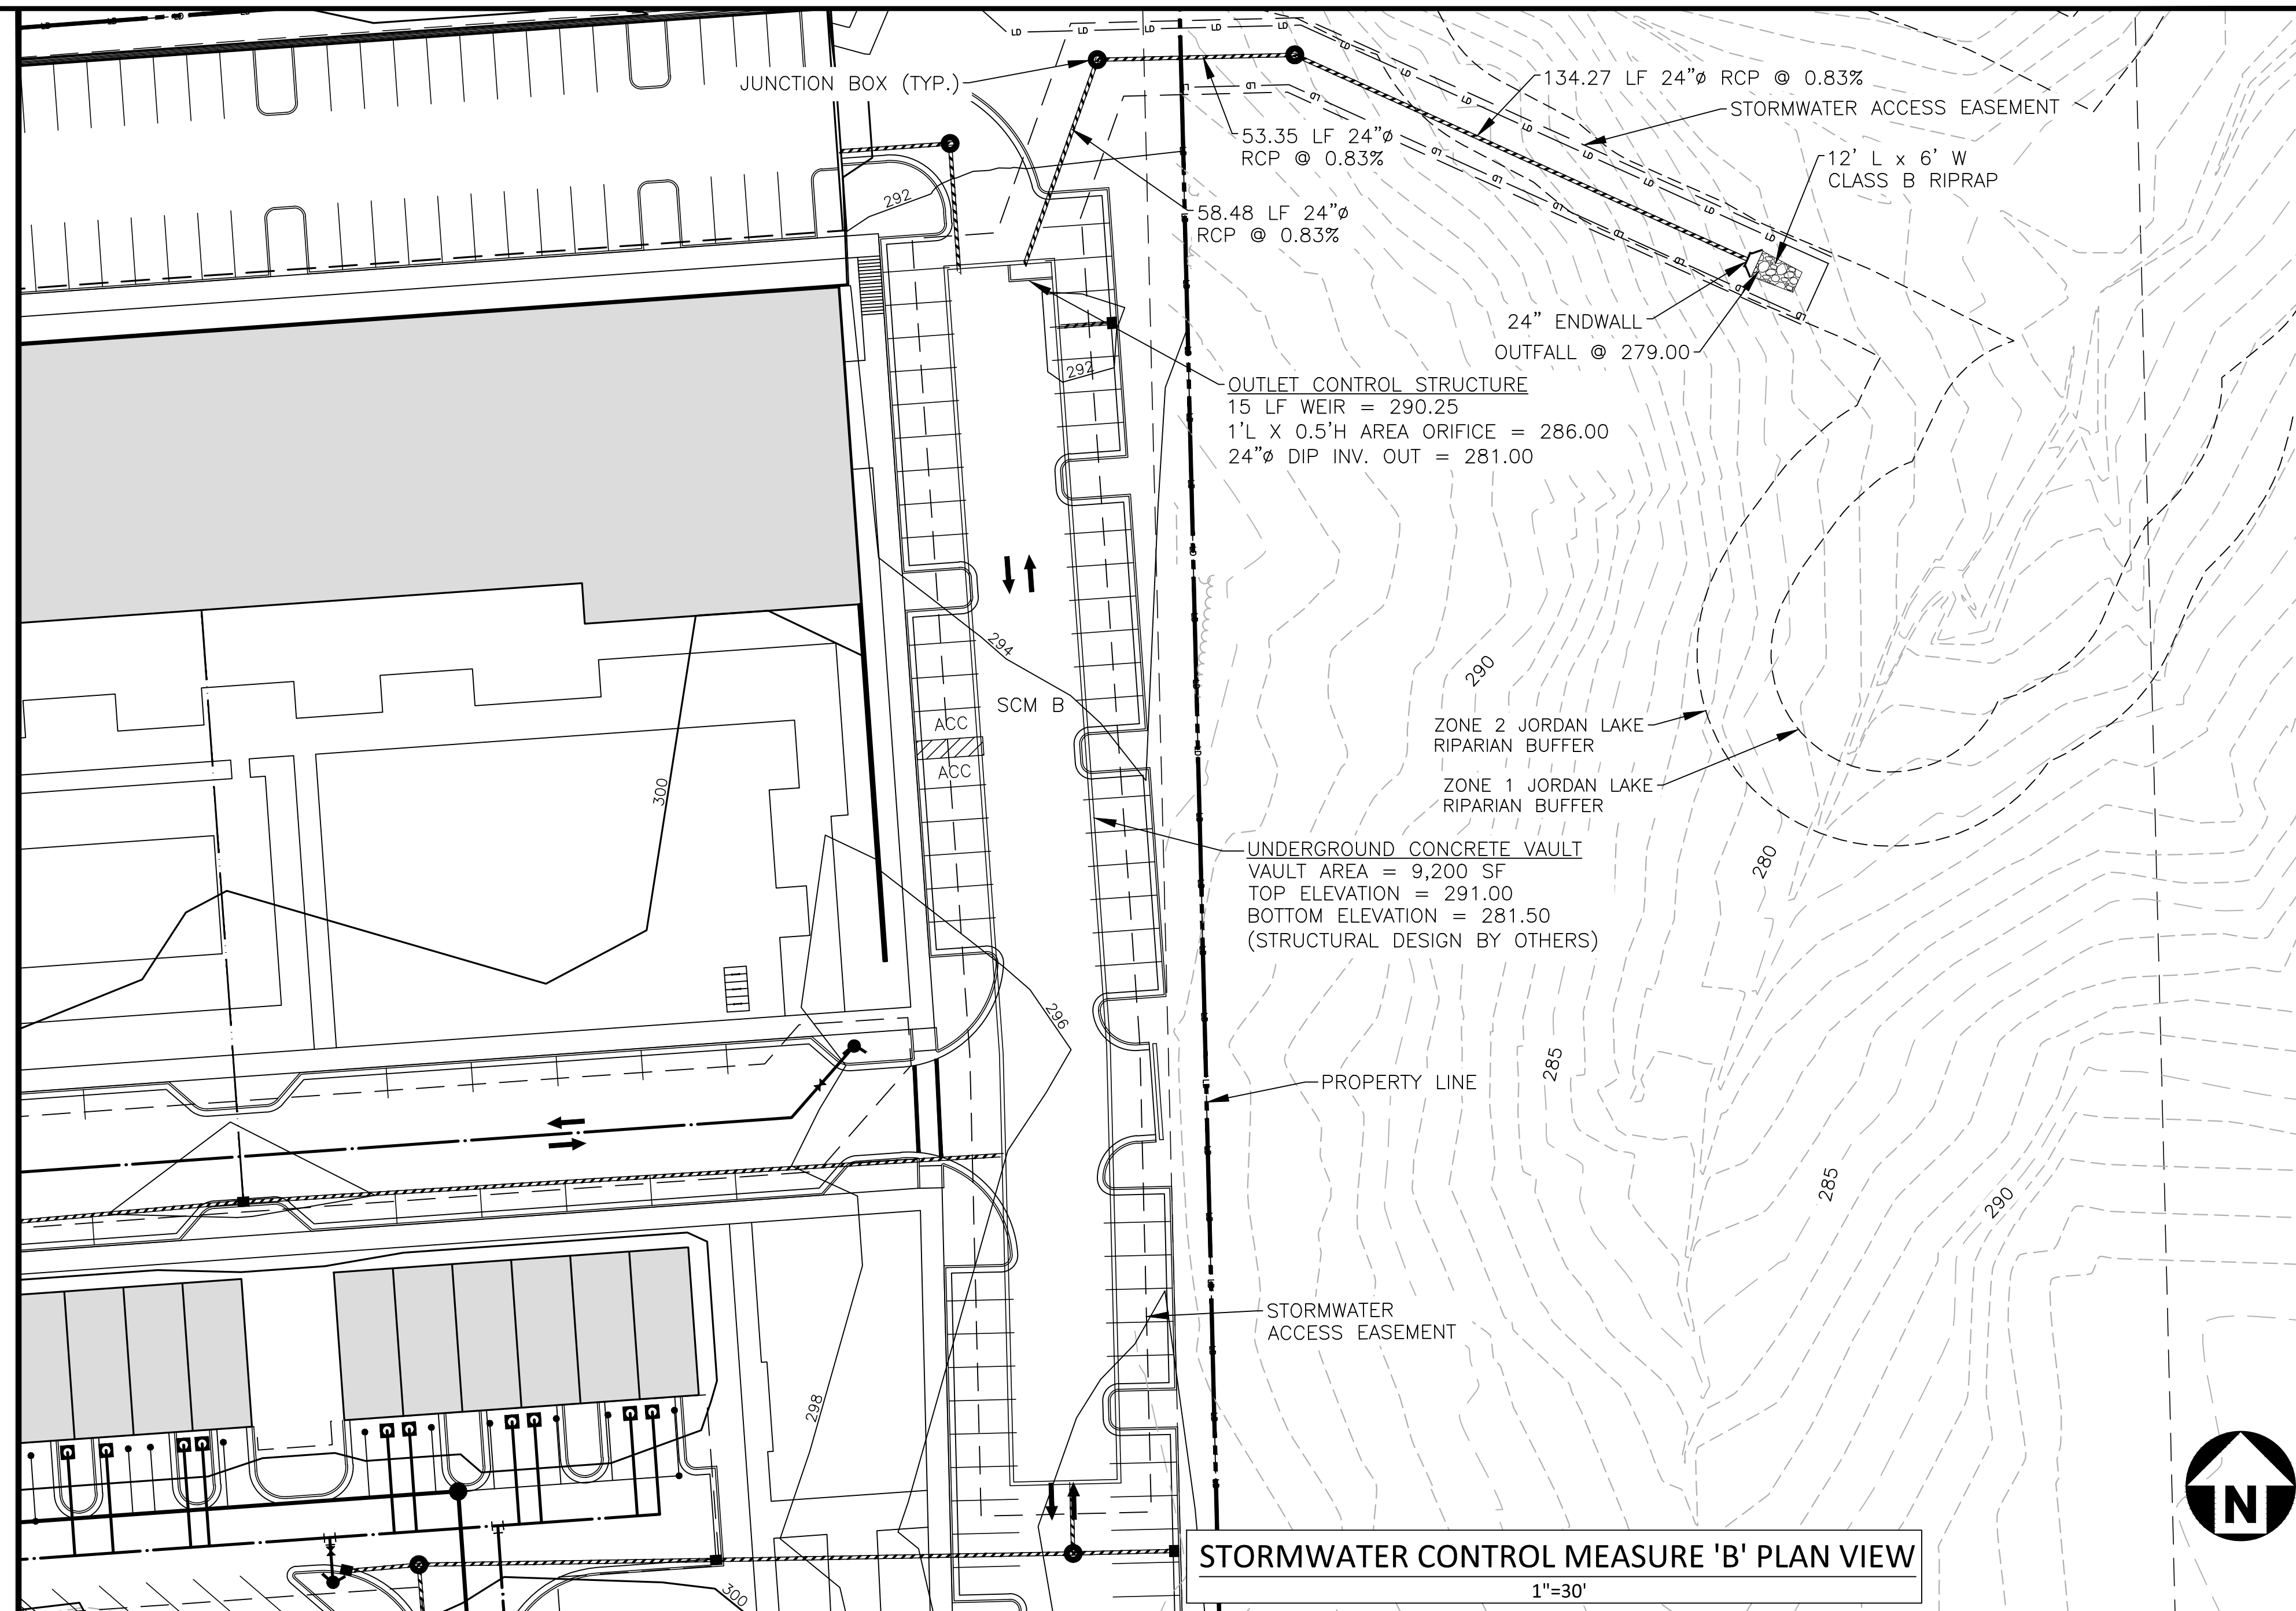

STORMWATER CONTROL MEASURE 'B' PLAN VIEW  
1"=30'

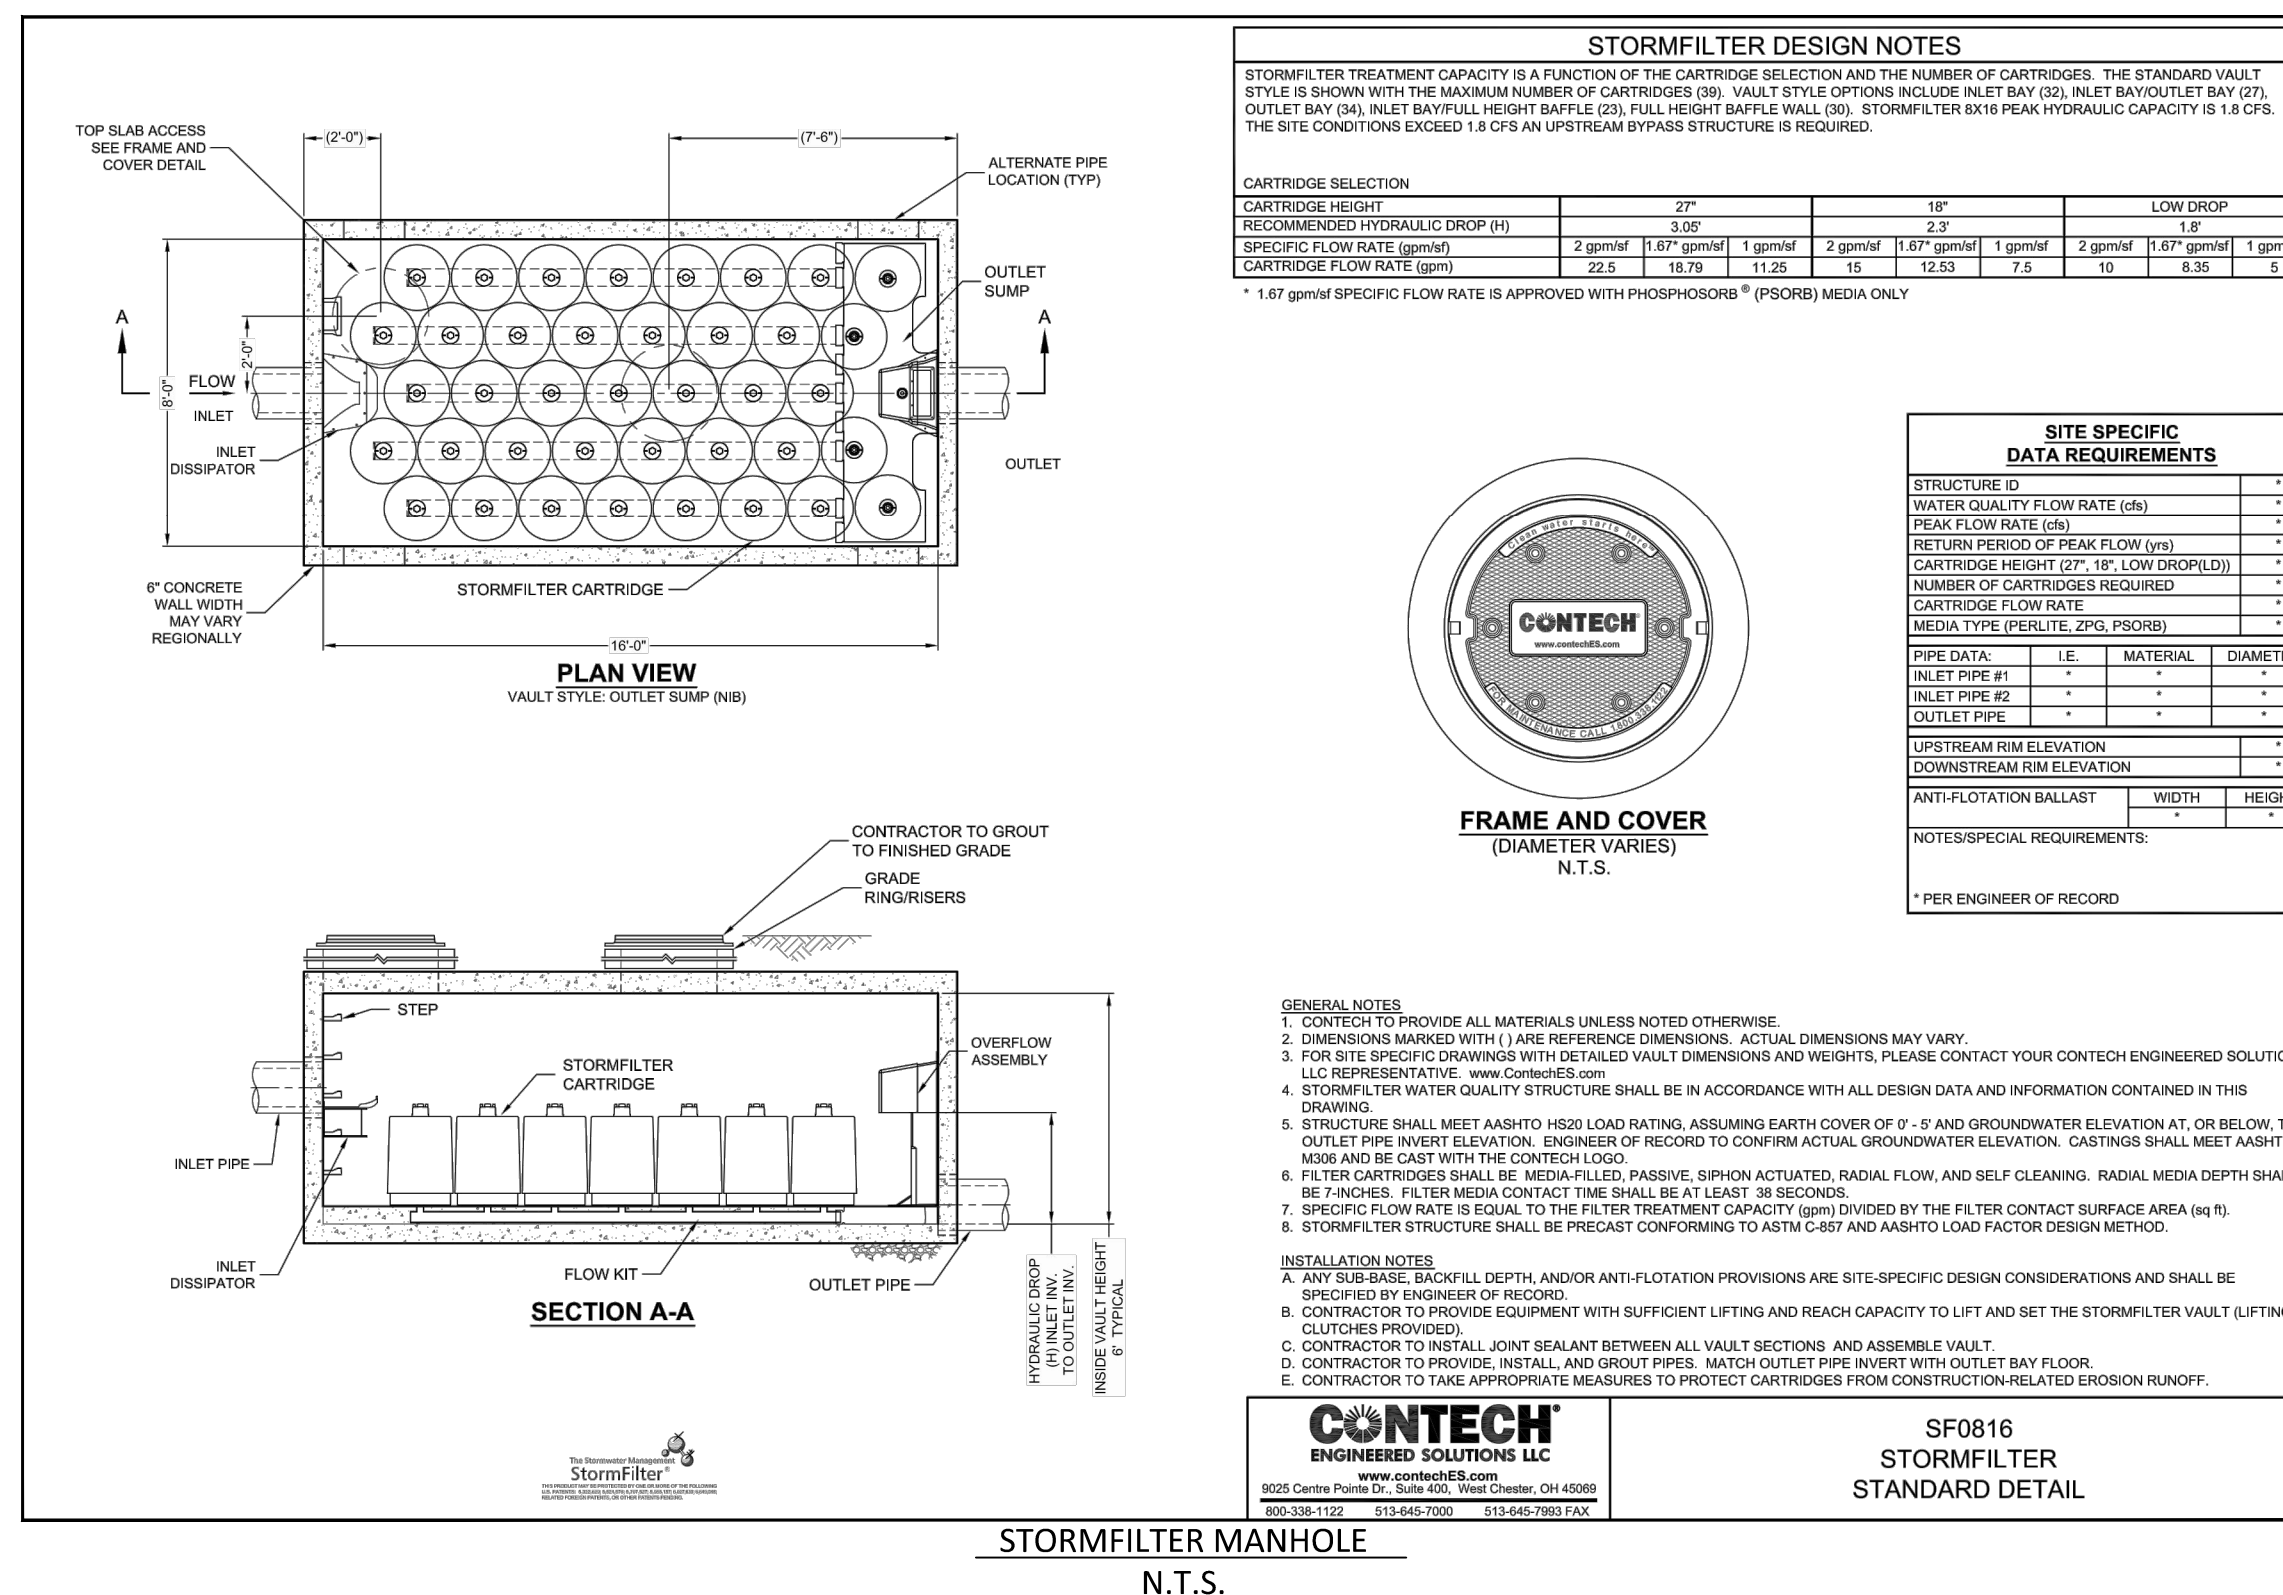


**McADAMS**  
The John R. McAdams Company, Inc.  
2905 Meridian Parkway  
Durham, NC 27713  
phone 919. 361. 5000  
fax 919. 361. 2269  
license number: C-0293, C-187  
www.mcadamsco.com

**CLIENT**  
TOLL BROTHERS APARTMENT LIVING  
1140 VIRGINIA DR  
FORT WASHINGTON, PA, 19034  
Contact  
PHONE: 202.577.6491



**BARBEE CHAPEL APARTMENTS**  
CONDITIONAL ZONING PERMIT  
DRAWINGS  
5101 BARBEE CHAPEL RD  
CHAPEL HILL, NC 27517

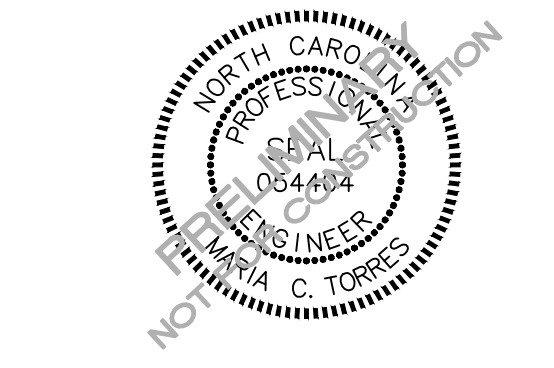

**REVISIONS**

NO.	DATE	REVISED PER
11.23.2022	REVISED PER	1ST CZP COMMENTS

**PLAN INFORMATION**

PROJECT NO. TLA-22001  
FILENAME TLA22001-SCMB  
CHECKED BY MCT  
DRAWN BY OVL  
SCALE 1" = 30'  
DATE 09.29.2022

**SCM B PLAN VIEW**  
**C9.01**

SEE SHEET C0.00 FOR ALL PROJECT, SITE, GRADING, STORM DRAINAGE AND UTILITY NOTES

ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE CURRENT TOWN OF CHAPEL HILL AND NCDOT ENGINEERING DESIGN AND CONSTRUCTION STANDARDS



1000 Lancaster street  
suite 430  
ballimore, md 21202  
t: 410.384.4244  
f: 443.569.6430  
www.ci-designinc.com

250 Summer Street  
2nd Floor  
Boston, Massachusetts 02210  
(800) 978.5606  
t 1 617.848.9511

530 Hillsborough St  
Raleigh, North Carolina 27603  
(800) 978.5606  
t 1 919.589.1820

**CLIENT**

TOLL BROTHERS APARTMENT LIVING  
1140 VIRGINIA DR  
FORT WASHINGTON, PA, 19034  
PHONE: 202.577.6491



**BARBEE CHAPEL APARTMENTS  
CONDITIONAL ZONING PERMIT  
DRAWINGS  
5101 BARBEE CHAPEL RD  
CHAPEL HILL, NORTH CAROLINA, 27517**

**REVISIONS**

NO.	DATE	REVISION DESCRIPTION
1	11/21/2022	1ST ROUND COMMENTS


**PLAN INFORMATION**

PROJECT NO.: P200798

SCALE: AS INDICATED  
DATE: 09/29/2022

**OVERALL SITE PLAN**

**L1.00**

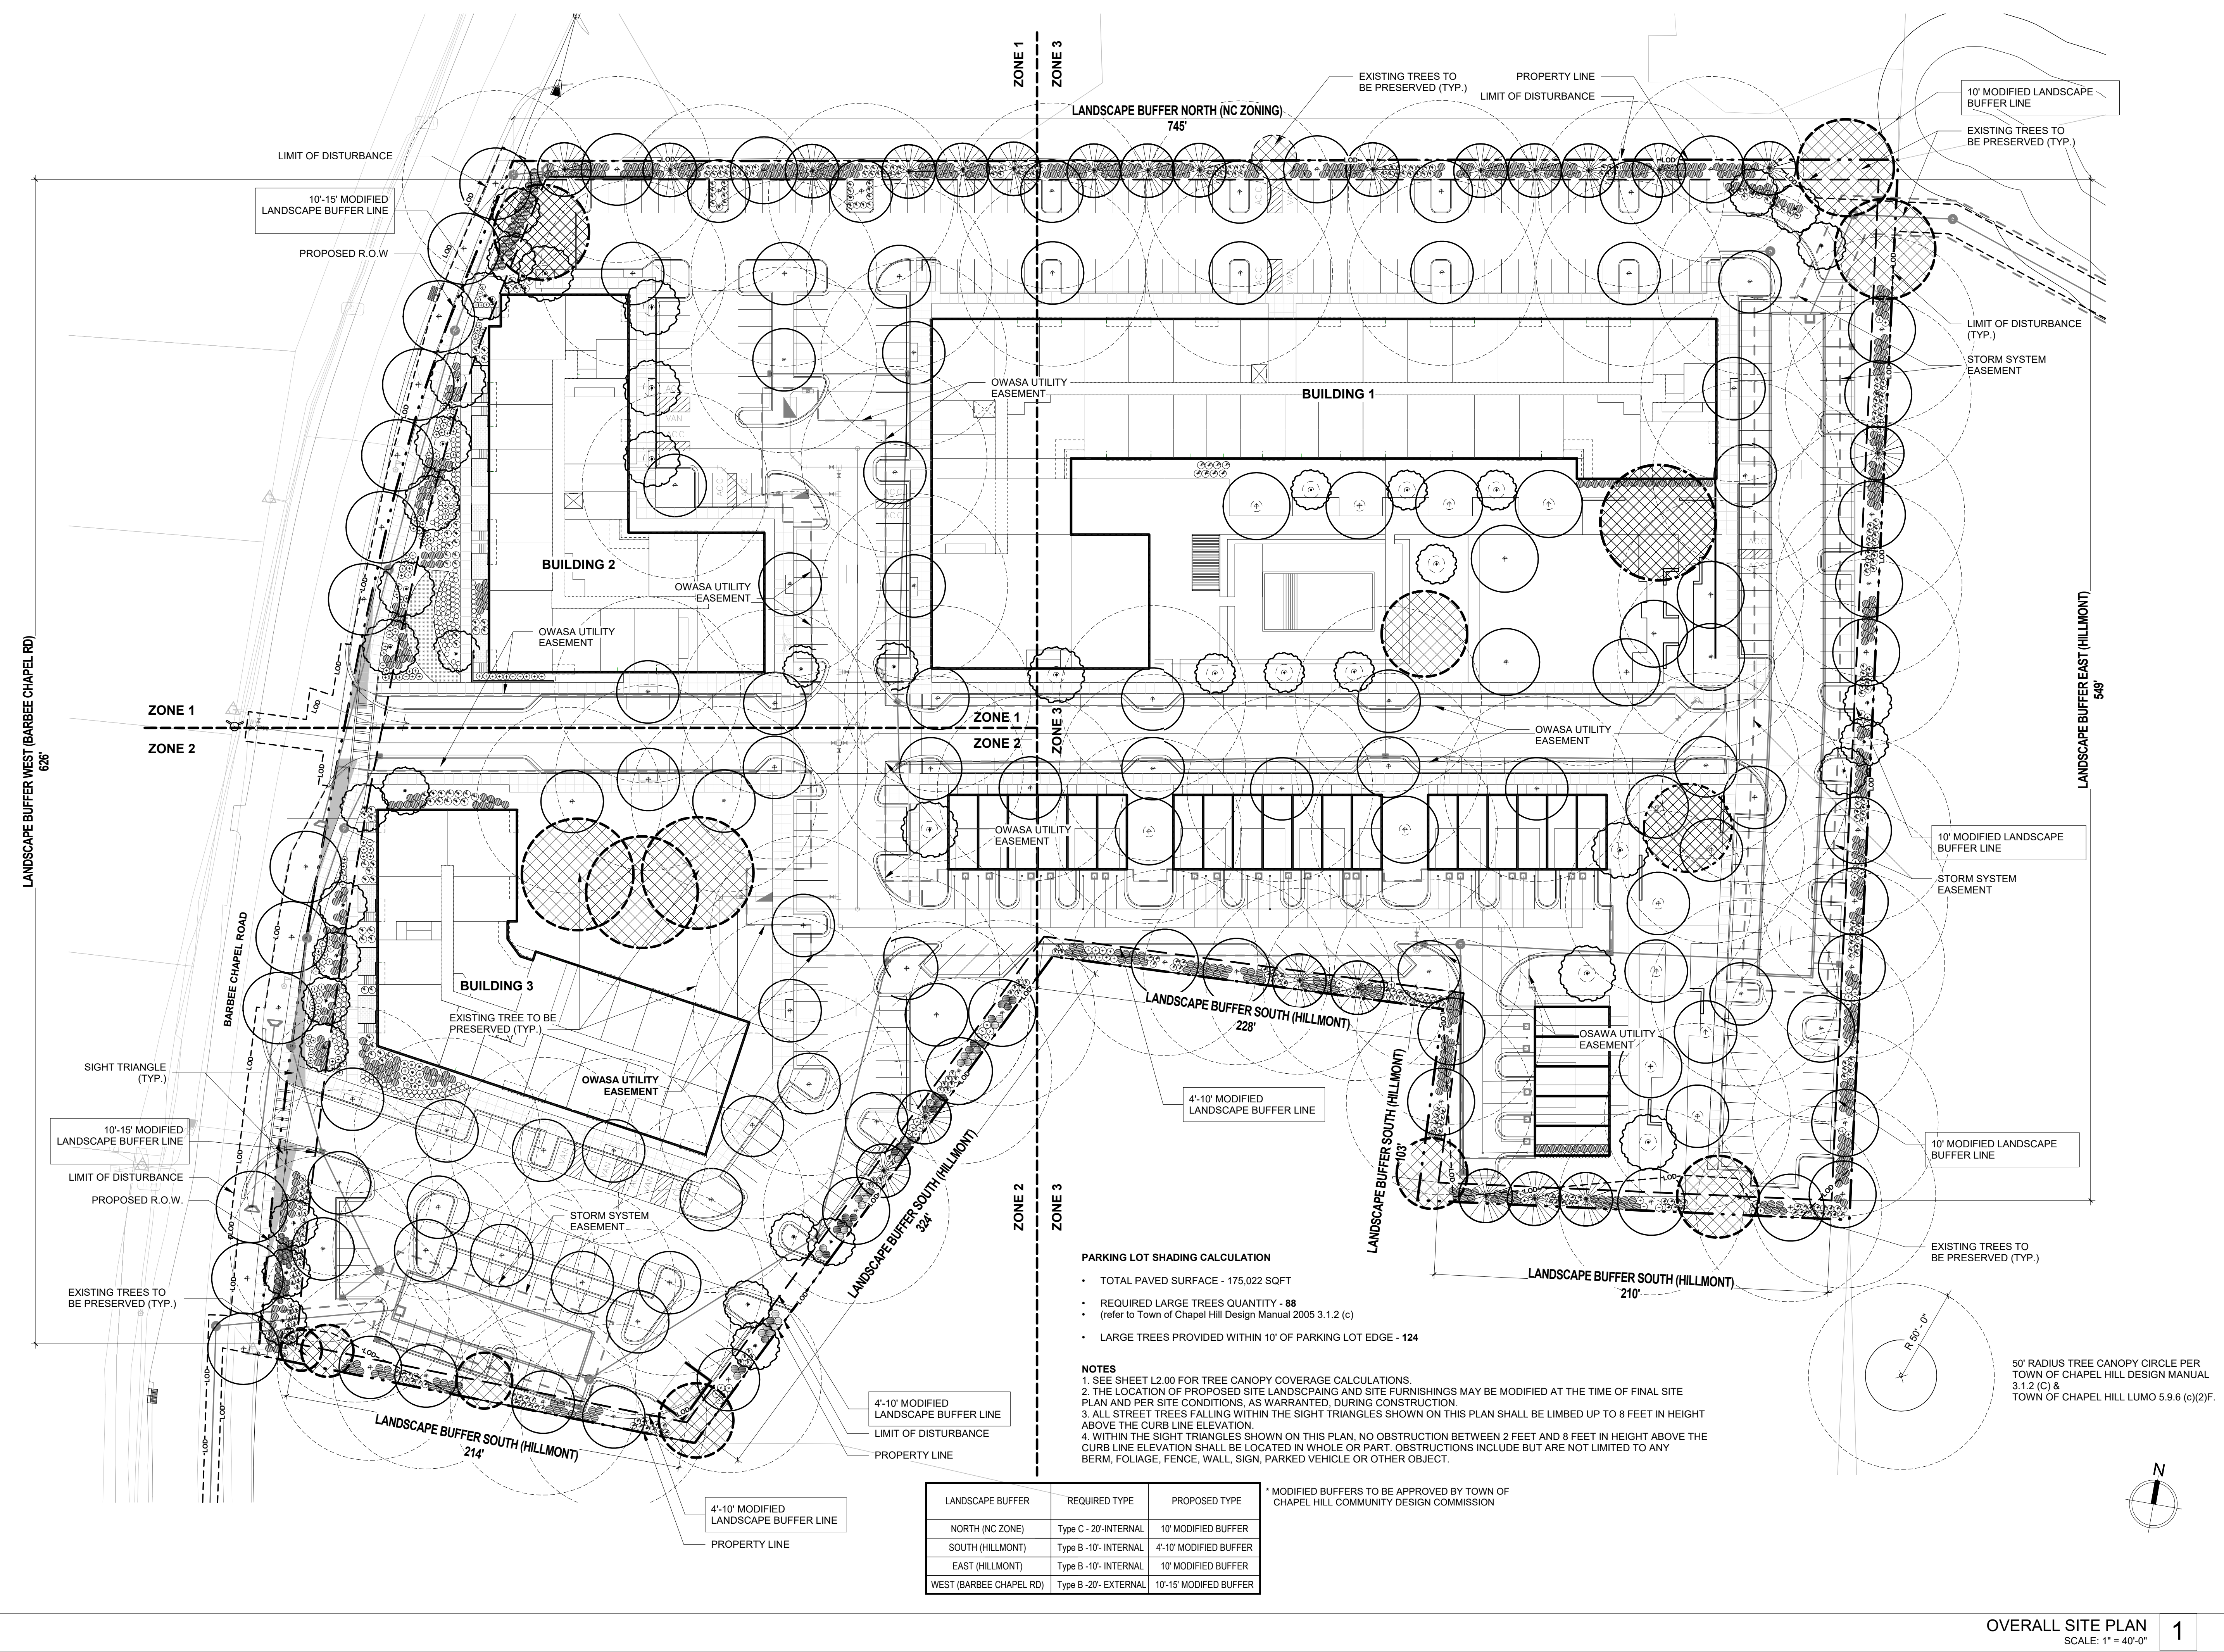

- PARKING LOT SHADING CALCULATION**
- TOTAL PAVED SURFACE - 175,022 SQFT
  - REQUIRED LARGE TREES QUANTITY - 88 (refer to Town of Chapel Hill Design Manual 2005 3.1.2 (c))
  - LARGE TREES PROVIDED WITHIN 10' OF PARKING LOT EDGE - 124

- NOTES**
1. SEE SHEET L2.00 FOR TREE CANOPY COVERAGE CALCULATIONS.
  2. THE LOCATION OF PROPOSED SITE LANDSCAPING AND SITE FURNISHINGS MAY BE MODIFIED AT THE TIME OF FINAL SITE PLAN AND PER SITE CONDITIONS, AS WARRANTED, DURING CONSTRUCTION.
  3. ALL STREET TREES FALLING WITHIN THE SIGHT TRIANGLES SHOWN ON THIS PLAN SHALL BE LIMBED UP TO 8 FEET IN HEIGHT ABOVE THE CURB LINE ELEVATION.
  4. WITHIN THE SIGHT TRIANGLES SHOWN ON THIS PLAN, NO OBSTRUCTION BETWEEN 2 FEET AND 8 FEET IN HEIGHT ABOVE THE CURB LINE ELEVATION SHALL BE LOCATED IN WHOLE OR PART. OBSTRUCTIONS INCLUDE BUT ARE NOT LIMITED TO ANY BERM, FOLIAGE, FENCE, WALL, SIGN, PARKED VEHICLE OR OTHER OBJECT.

LANDSCAPE BUFFER	REQUIRED TYPE	PROPOSED TYPE
NORTH (NC ZONE)	Type C - 20'-INTERNAL	10' MODIFIED BUFFER
SOUTH (HILLMONT)	Type B - 10'- INTERNAL	4'-10' MODIFIED BUFFER
EAST (HILLMONT)	Type B - 10'- INTERNAL	10' MODIFIED BUFFER
WEST (BARBEE CHAPEL RD)	Type B - 20'- EXTERNAL	10'-15' MODIFIED BUFFER

\* MODIFIED BUFFERS TO BE APPROVED BY TOWN OF CHAPEL HILL COMMUNITY DESIGN COMMISSION